


COPYRIGHT © 2009 EMCON
 ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED STORED IN A RETRIEVAL SYSTEM OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC, MECHANICAL, PHOTOCOPYING, RECORDING OR OTHERWISE, WITHOUT THE PERMISSION IN WRITING FROM EMCON.

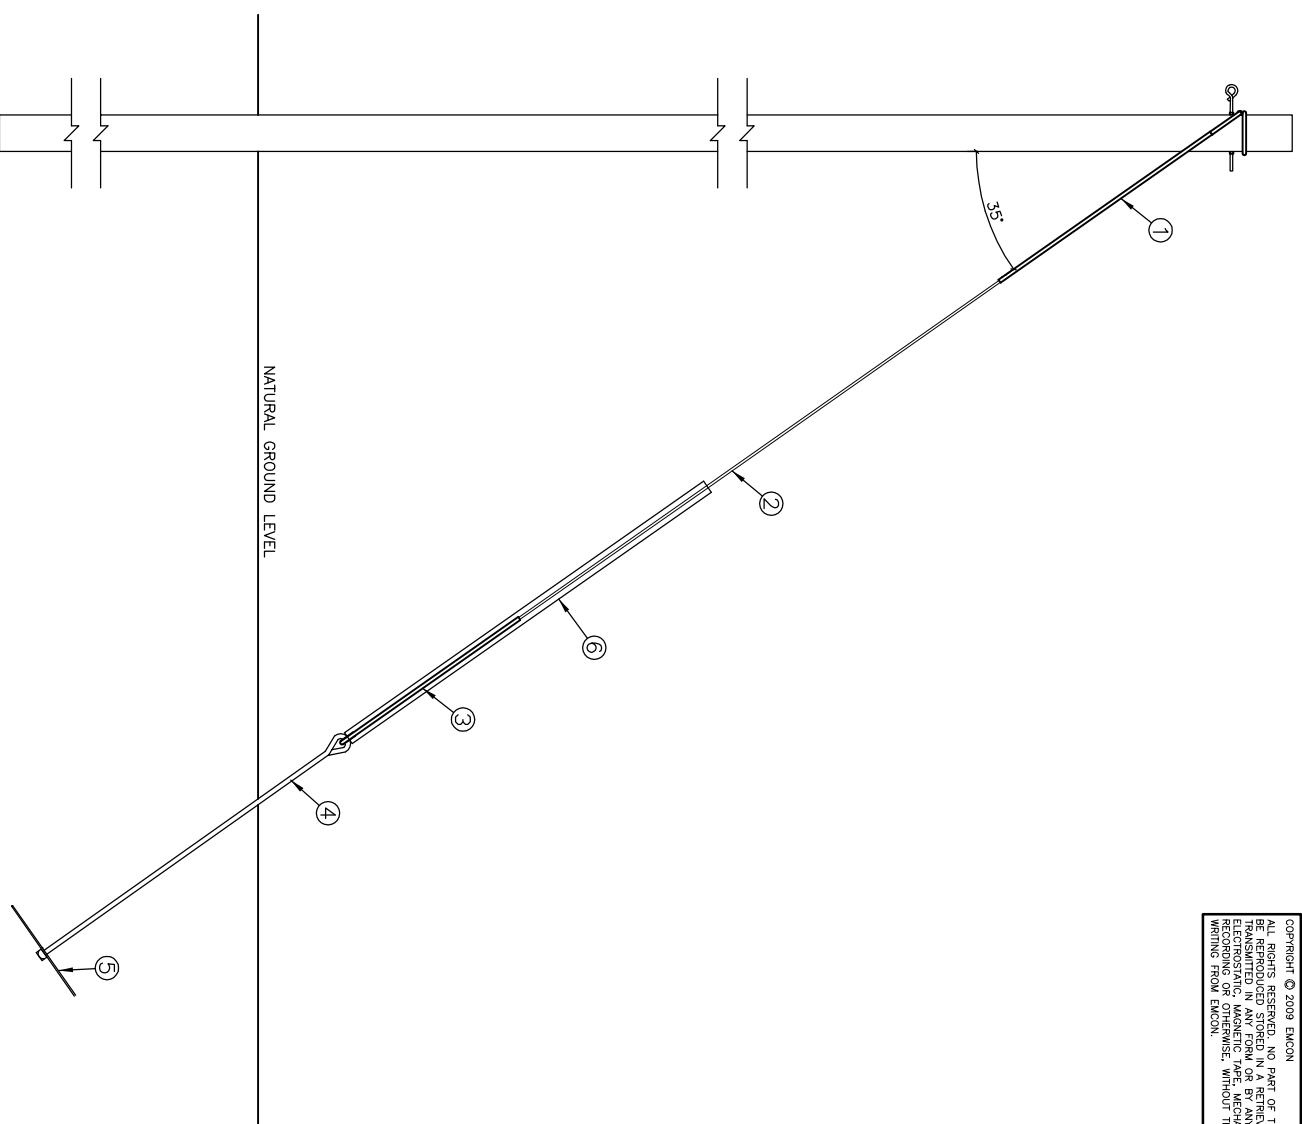


ITEM	DESCRIPTION	QTY	REMARKS
1	DOUBLE WRAP GUY GRIP	1	DMG 432
2	STAY WIRE	12m	5/4.00 STAY WIRE
3	GUY GRIP	1	GSD 432
4	STAY ROD C/W THIMBLE	1	1800 x 16mm
5	BASE PLATE	1	300x300x6mm GMS
6	GUARD WARNING PIPE	1	

NOTES:

- STAY ASSEMBLY GUARD WARNING PIPE TO BE INSTALLED ONTO STAY ASSEMBLY, WHERE SPECIFIED.

ELECTRICITY CONTROL BOARD



Box 2923
 Windhoek
 NAMIBIA
 Tel: (061) 374300
 Fax: (061) 374305

DRAWING TITLE
 LOW VOLTAGE AERIAL BUNDLE CONDUCTOR
 DISTRIBUTION: STAY ASSEMBLY
 -VILLAGE INTERNAL NETWORK-

DESIGNED: A.K	DRAWN: J.W.S	REV: 01-2001
DRAWING No: STD-LVBOH-15		SCALE: N.T.S

ERROR: syntaxerror
OFFENDING COMMAND: --nostringval--

STACK:

/Title
()
/Subject
(D:20100127093745+02'00')
/ModDate
()
/Keywords
(PDFCreator Version 0.9.5)
/Creator
(D:20100127093745+02'00')
/CreationDate
(johnny)
/Author
-mark-