


**Annex B1- Internal Pole Inspection and Treatment for Class 1 and 2 poles  
(for rural poles 10m and longer)  
(Normative)**

To be used in conjunction with the text of this specification

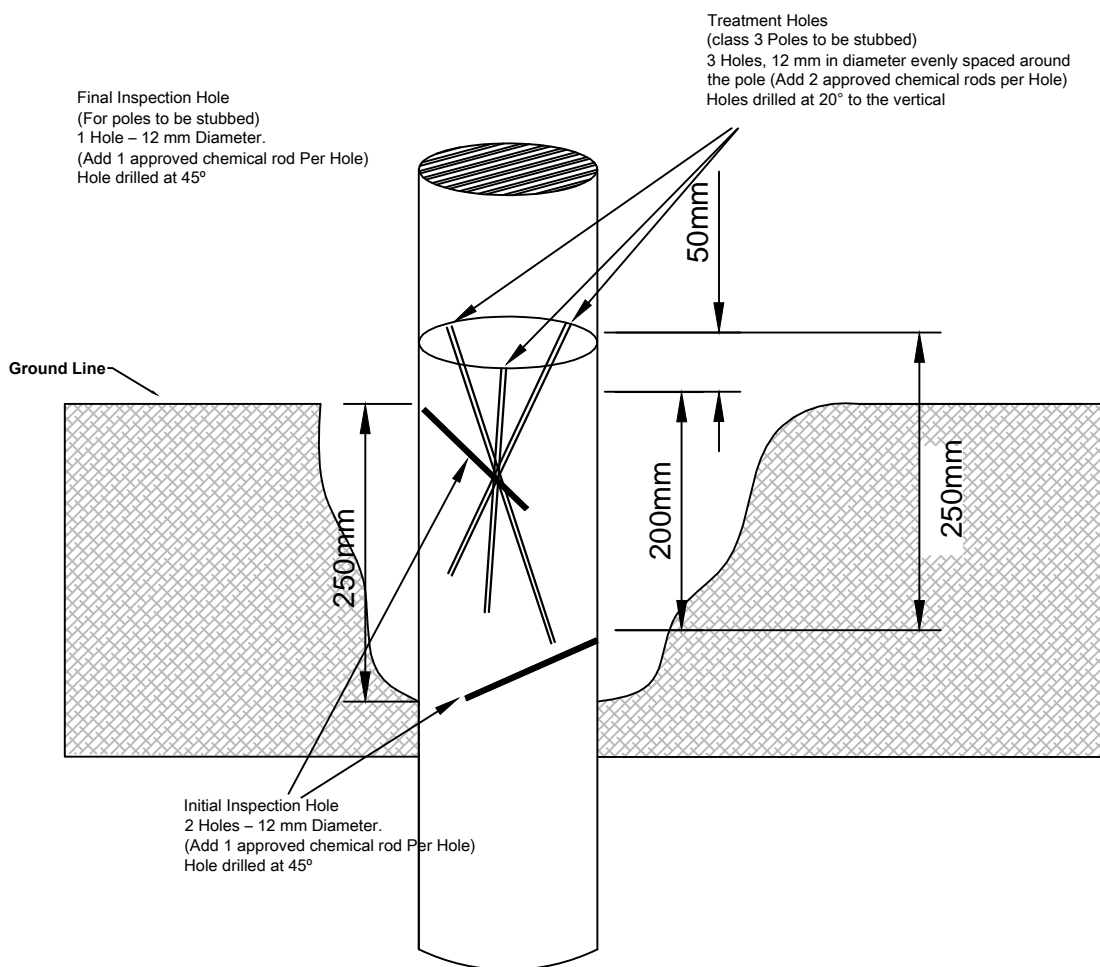

**Notes:**

- 1) All poles to be excavated and inspected as indicated in this annex. See 2.2.5 and 2.2.7 for more detail.
- 2) 2 Class 1 and 2 poles to have an approved chemicals applied internally below the ground. See 2.3.2 for more detail.
- 3) Where shell rot is present, an approved external chemical is to be applied. See 2.2.6 and 2.3.2 for more details.
- 4) All inspection and treatment holes to be plugged with a removable plastic dowel plug.